


Notes

BRC 944 Requires Daikin Connection Cable
3 Meter - BRCW901A03 / 8 Meter - BRCW901A08

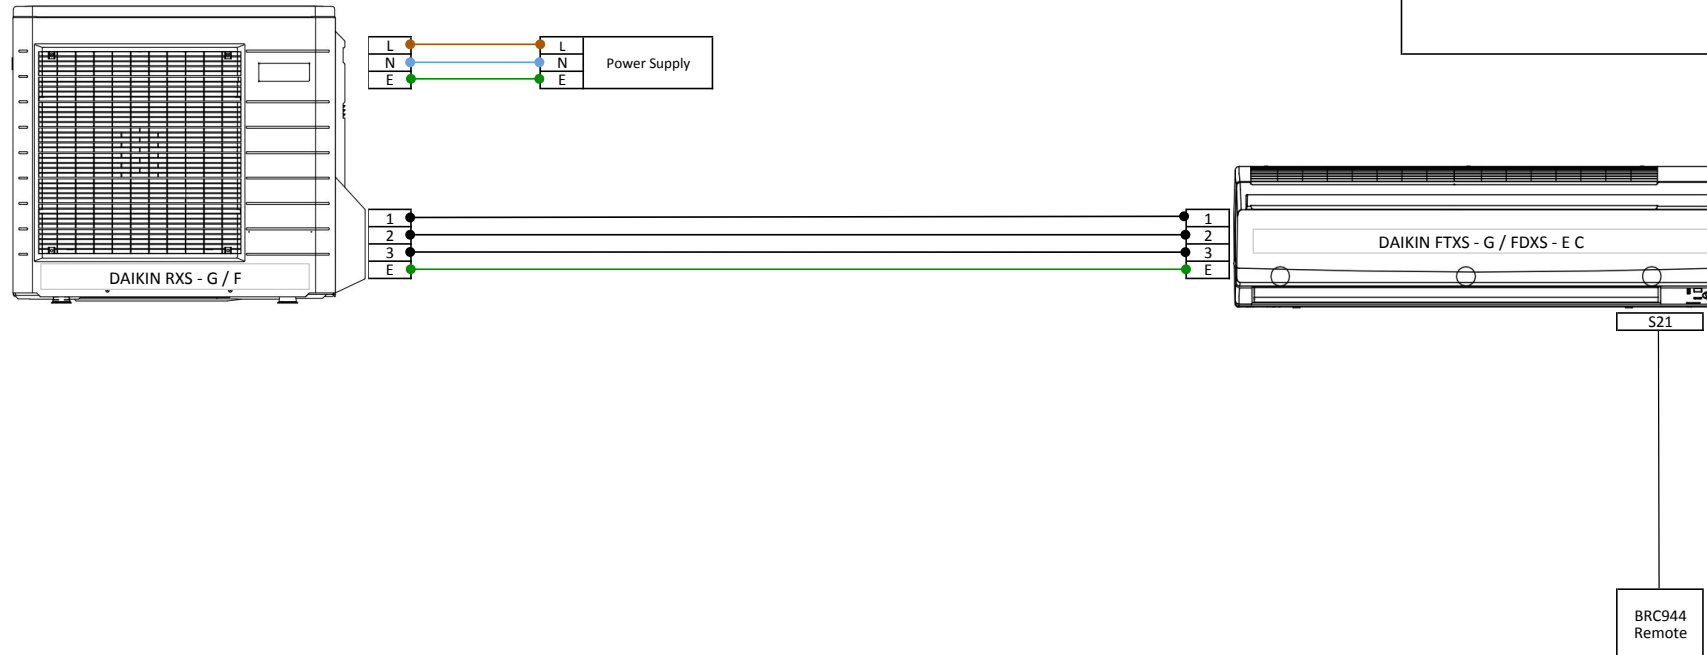

intelligent comfort group

Drawing Title	FTXS-G / FDXS-E C HW CONTROL
Date	28th March 2011
Drawn By	Richard Jones
Project Reference	GENERIC
Note - This document should be used as a guide only, always read the installation manual supplied with the equipment you are installing.	