


Notes
 Change Setting 19 Switch 8 to 03 or 04 on VAM unit
 Mount BRP4A50 On VAM Unit
 Mount Heter Relay Box local to duct heater
 Duct Heater temperature controls not shown. Type C controls should be used consult Systemair data for further information.

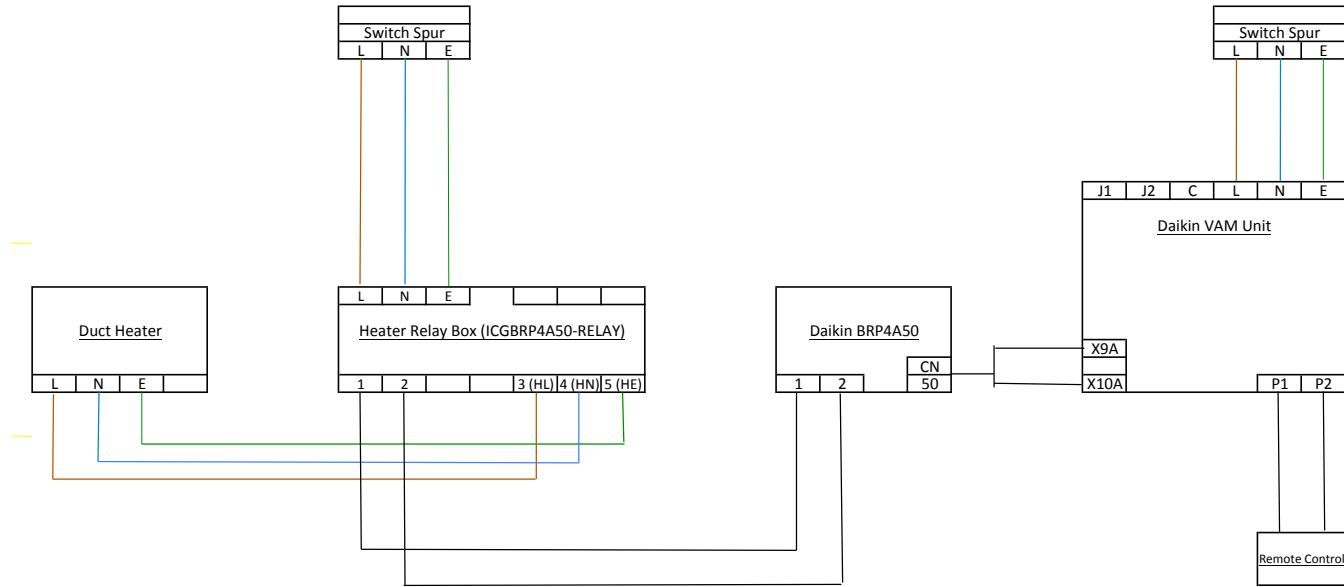

intelligent comfort group

Drawing Title	Daikin VAM Aux Heater Control (BRP4A50)
Date	28th March 2011
Drawn By	Richard Jones
Project Reference	GENERIC
Note - This document should be used as a guide only, always read the installation manual supplied with the equipment you are installing.	